



SINCE 1908
wessels
 company

SUBMITTAL



TYPE: WP-SERIES INSULATION PACKAGE
 FOR PLATE HEAT EXCHANGERS

Models: WP47

Submittal Sheet No. A-40A

Date: 2/2014

Job Name _____	Submitted By _____	Date _____
Location _____	Approved By _____	Date _____
_____	Order No. _____	Date _____
Engineer _____	Notes _____	
Contractor _____	_____	
Sales Rep. _____	_____	

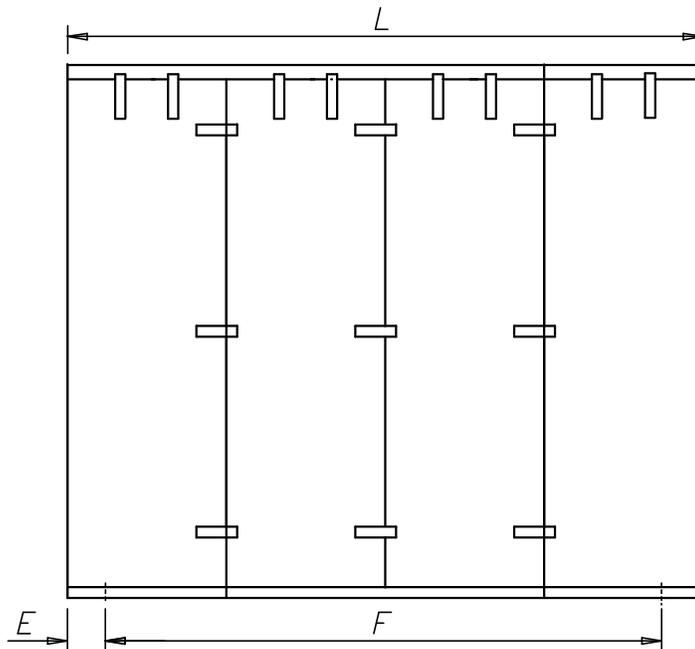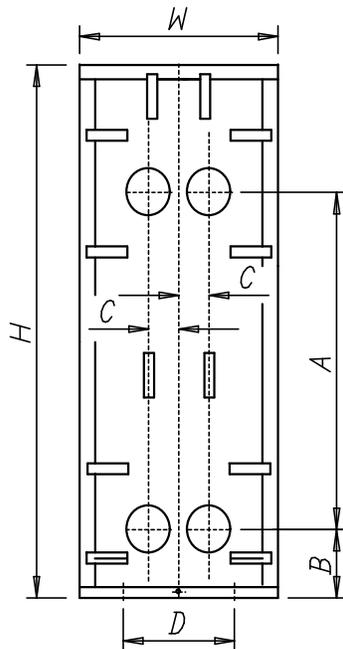

Dimensional Data (inches)

A:	52.0	Frame Size	24	36	48	60	72	84	96	108
B:	12.0	F:	32.5	44.5	56.5	68.5	80.5	92.5	104.5	116.5
C:	5.9	L:	46	58	70	82	94	106	118	130
D:	20.3	E:	4.0	H:	81.0	W:	30.0	Mounting Holes	D/F: 3 @ 0.75	

Specification

Provide a plate heat exchanger insulation package with a minimum R-13 that consists of self supporting removeable panels held together with clasps mounted in a drip tray.

Construction

Insulation Board: 2" Polyisocyanurate foam core with reinforced polymer reflective foil outer face with reinforced coated inner face.

Drip Tray: Galvanized steel walls and heat exchanger mounting blocks. A 1/2" NPT drain is provided.

Specification

Provide a plate heat exchanger insulation package with a minimum R-13 that consists of self supporting removeable panels held together with clasps mounted in a drip tray.

Installation

Install drip tray over anchor bolts on a flat level surface. Mount heat exchanger over anchor bolts; resting on mounting blocks provided in drip tray. Install insulation panels. Clasps to be high strength with over center catch and strile zinc coated steel.