

END SUCTION GENERAL PURPOSE PUMPS

Series 2000 — Bare Pump


PUMP OUTLINE

SECTION 2330

Page 13

July 5, 1991

DISCHARGE - NPT

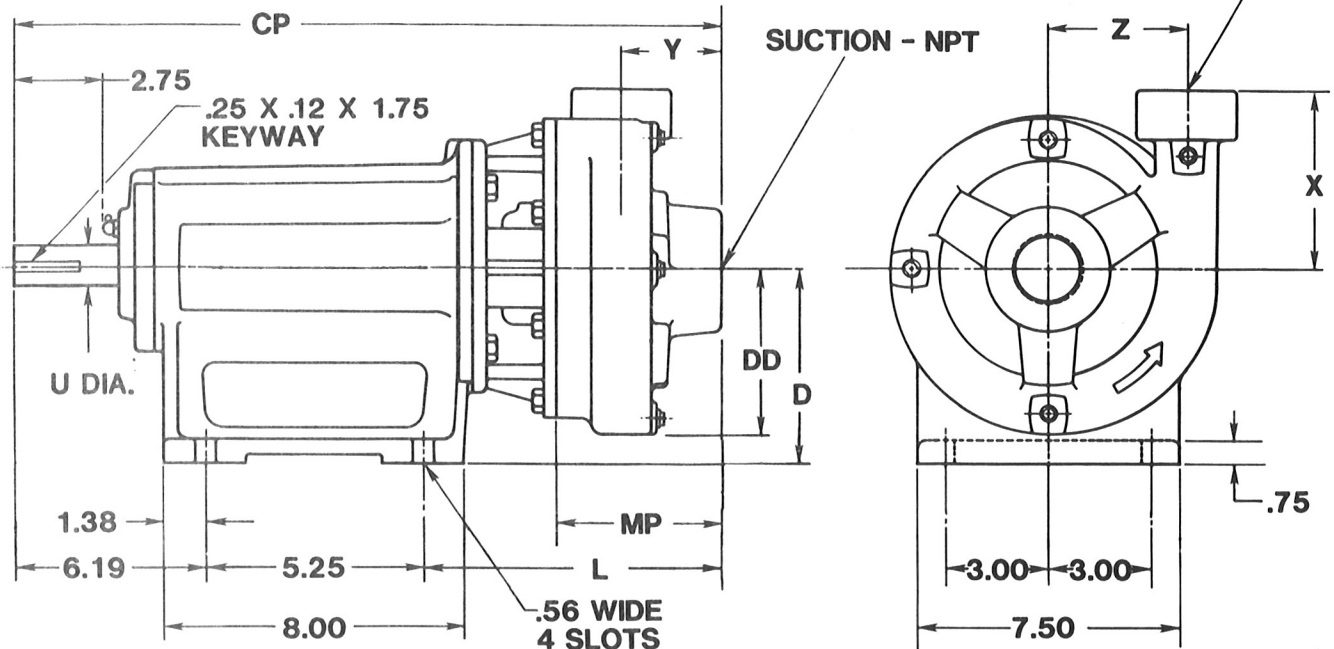

Pump Series, Type & Style	PUMP DIMENSIONS — INCHES											Approximate Weight — Lbs.
	Suction Size	Discharge Size	CP	D	DD	L	MP	U +.000 -.001	X	Y	Z	
F1610AM	2.0	1.0	19.44	5.31	4.25	8.00	4.12	1.125	4.75	2.62	3.38	87
F1610AP	2.0	1.0	22.44	5.31	4.25	11.00	4.12	1.125	4.75	2.62	3.38	93
F1615AM	2.0	1.5	19.69	5.31	4.38	8.25	4.38	1.125	5.00	2.75	3.62	88
F1615AP	2.0	1.5	22.69	5.31	4.38	11.25	4.38	1.125	5.00	2.75	3.62	93
F1615JM	2.0	1.5	19.69	5.31	4.38	8.25	4.38	1.125	5.00	2.75	3.62	88
F1615JP	2.0	1.5	22.69	5.31	4.38	11.25	4.38	1.125	5.00	2.75	3.62	93
F1620AM	2.5	2.0	20.19	5.31	4.50	8.75	4.88	1.125	5.38	3.25	3.62	89
F1620AP	2.5	2.0	23.19	5.31	4.50	11.75	4.88	1.125	5.38	3.25	3.62	94
F1810AM	2.0	1.0	19.56	5.31	5.25	8.12	4.25	1.125	5.12	2.75	4.38	98
F2810AM	2.0	1.0	21.19	6.31	5.25	9.75	4.25	1.250	5.12	2.75	4.38	126
F1810AP	2.0	1.0	22.56	5.31	5.25	11.12	4.25	1.125	5.12	2.75	4.38	105
F2810AP	2.0	1.0	23.94	6.31	5.25	12.50	4.25	1.250	5.12	2.75	4.38	134
F1815AM	2.0	1.5	19.56	5.31	5.38	8.12	4.25	1.125	5.50	2.75	4.50	100
F1815GM	2.0	1.5	19.56	5.31	5.38	8.12	4.25	1.125	5.50	2.75	4.50	100
F1815AP	2.0	1.5	22.56	5.31	5.38	11.12	4.25	1.125	5.50	2.75	4.50	128
F1815GP	2.0	1.5	22.56	5.31	5.38	11.12	4.25	1.125	5.50	2.75	4.50	128
F2815AP	2.0	1.5	23.94	6.31	5.38	12.62	4.25	1.250	5.50	2.75	4.50	136
F1820AM	2.5	2.0	20.06	5.31	5.50	8.62	4.75	1.125	6.00	3.12	4.62	99
F2820AM	2.5	2.0	21.69	6.31	5.50	10.25	4.75	1.250	6.00	3.12	4.62	127
F1820AP	2.5	2.0	23.06	5.31	5.50	11.62	4.75	1.125	6.00	3.12	4.62	106
F2820AP	2.5	2.0	24.44	6.31	5.50	13.12	4.75	1.250	6.00	3.12	4.62	135
F21215AM	2.0	1.5	21.25	6.31	7.50	9.81	4.94	1.250	7.50	3.00	6.75	167
F21215AP	2.0	1.5	24.00	6.31	7.50	12.56	4.94	1.250	7.50	3.00	6.75	173

CUSTOMER _____ JOB NAME _____
P.O. NO. _____ ITEM NO. _____
S.O. NO. _____ SERIAL NO. _____
PUMP SERIES, TYPE, STYLE _____ RPM _____ G.P.M. _____ TOTAL HD. FT. _____
CERTIFIED FOR ☐ APPROVAL ☐ CONSTRUCTION BY _____ DATE _____

Subject to change unless certified for construction.


DT4851775
Rev. 2-89

END SUCTION GENERAL PURPOSE PUMPS

Series 2000 — Bare Pump



PUMP OUTLINE

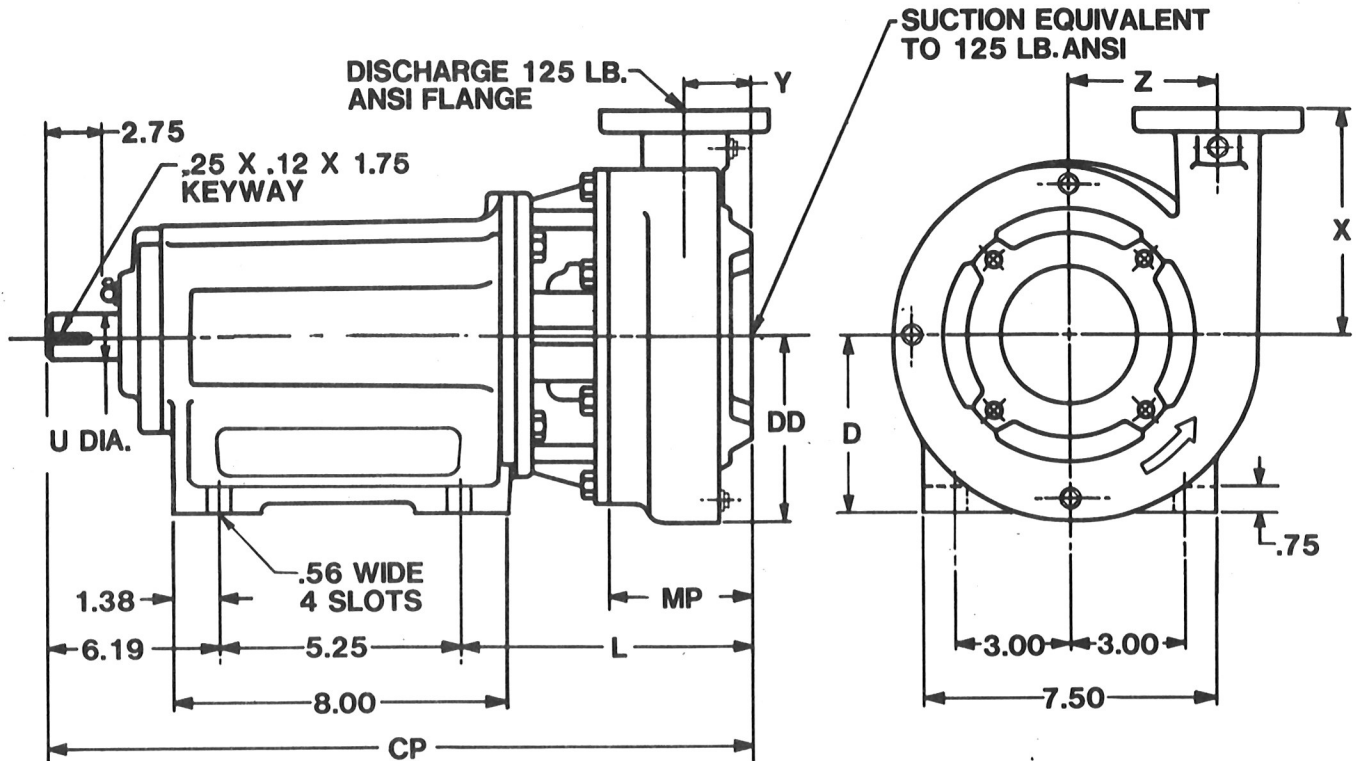


✓	Pump Series, Type & Style	PUMP DIMENSIONS — INCHES											Approximate Weight — Lbs.
		Suction Size	Discharge Size	CP	D	DD	L	MP	U +.000 -.001	X	Y	Z	
	F1740M	5.0	4.0	19.94	5.31	7.25	8.50	4.64	1.125	7.38	2.64	5.50	146
	F2740M	5.0	4.0	21.69	6.31	7.25	10.25	4.64	1.250	7.38	2.64	5.50	164
	F1740P	5.0	4.0	22.94	5.31	7.25	11.50	4.64	1.125	7.38	2.64	5.50	150
	F2740P	5.0	4.0	24.44	6.31	7.25	13.00	4.64	1.250	7.38	2.64	5.50	168
	F1825AM	3.0	2.5	19.19	5.31	5.75	7.75	3.88	1.125	7.25	2.25	4.88	114
	F2825AM	3.0	2.5	20.94	6.31	5.75	9.50	3.88	1.250	7.25	2.25	4.88	142
	F1825AP	3.0	2.5	22.19	5.31	5.75	10.75	3.88	1.125	7.25	2.25	4.88	114
	F2825AP	3.0	2.5	23.69	6.31	5.75	12.25	3.88	1.250	7.25	2.25	4.88	150
	F1830AM	4.0	3.0	19.19	5.31	6.50	7.75	3.88	1.125	7.50	2.12	5.25	125
	F2830AM	4.0	3.0	20.82	6.31	6.50	9.38	3.88	1.250	7.50	2.12	5.25	154
	F1830AP	4.0	3.0	22.19	5.31	6.50	10.75	3.88	1.125	7.50	2.12	5.25	132
	F2830AP	4.0	3.0	23.56	6.31	6.50	12.12	3.88	1.250	7.50	2.12	5.25	161
	F1840M	5.0	4.0	20.82	5.31	7.25	9.38	5.44	1.125	7.38	3.00	5.88	155
	F1840P	5.0	4.0	23.82	5.31	7.25	12.38	5.44	1.125	7.38	3.00	5.88	162
	F11020AM	2.5	2.0	19.56	5.31	6.75	8.12	4.25	1.125	7.00	2.50	5.88	134
	F21020AM	2.5	2.0	21.44	6.31	6.75	10.00	4.25	1.250	7.00	2.50	5.88	157
	F11020AP	2.5	2.0	22.56	5.31	6.75	11.12	4.25	1.125	7.00	2.50	5.88	139
	F21020AP	2.5	2.0	24.25	6.31	6.75	12.81	4.25	1.250	7.00	2.50	5.88	166
	F11025AM	3.0	2.5	19.69	5.31	7.12	8.25	4.12	1.125	7.50	2.25	5.88	132
	F21025AM	3.0	2.5	21.32	6.31	7.12	9.88	4.12	1.250	7.50	2.25	5.88	155
	F11025AP	3.0	2.5	22.69	5.31	7.12	11.25	4.12	1.125	7.50	2.25	5.88	137
	F21025AP	3.0	2.5	24.12	6.31	7.12	12.68	4.12	1.250	7.50	2.25	5.88	164

CUSTOMER _____ JOB NAME _____
P.O. NO. _____ ITEM NO. _____
S.O. NO. _____ SERIAL NO. _____
PUMP SERIES, TYPE, STYLE _____ RPM _____ G.P.M. _____ TOTAL HD. FT. _____
CERTIFIED FOR ☐ APPROVAL ☐ CONSTRUCTION BY _____ DATE _____

END SUCTION GENERAL PURPOSE PUMPS

Series 2000 — Bare Pump

PUMP OUTLINE

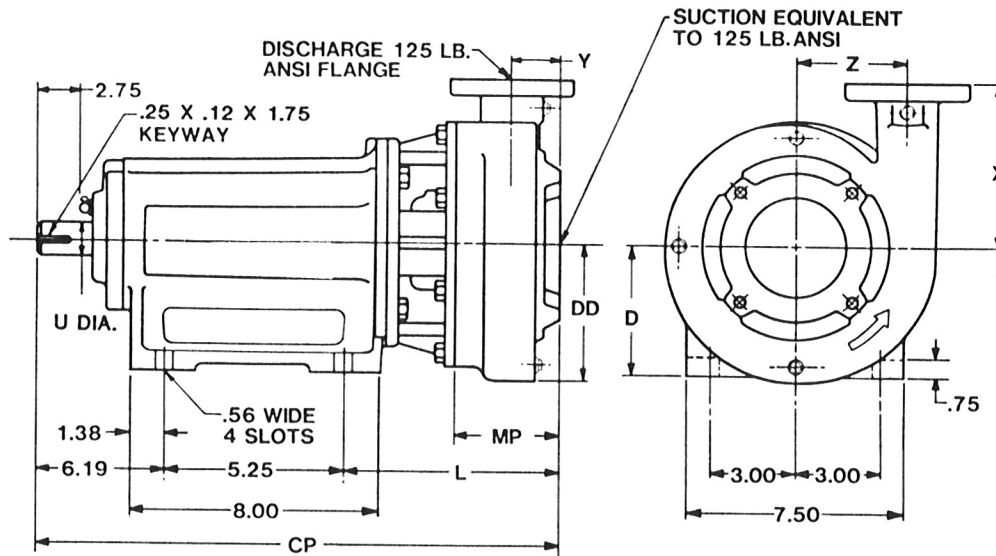

✓ Pump Series, Type & Style	PUMP DIMENSIONS — INCHES											Approximate Weight — Lbs.
	Suction Size	Discharge Size	CP	D	DD	L	MP	U +.000 -.001	X	Y	Z	
F11030AM	4.0	3.0	19.69	5.31	7.50	8.25	4.72	1.125	7.50	2.12	6.25	148
F21030AM	4.0	3.0	21.94	6.31	7.50	10.50	4.72	1.250	7.50	2.12	6.25	171
F11030AP	4.0	3.0	22.69	5.31	7.50	11.25	4.72	1.125	7.50	2.12	6.25	153
F21030AP	4.0	3.0	24.72	6.31	7.50	13.28	4.72	1.250	7.50	2.12	6.25	180
F21040AM	5.0	4.0	22.19	6.31	8.12	10.75	5.00	1.250	8.00	2.88	7.00	193
F21040AP	5.0	4.0	24.94	6.31	8.12	13.50	5.00	1.250	8.00	2.88	7.00	204
F21050AM	6.0	5.0	23.19	6.31	8.75	11.75	6.25	1.250	9.00	3.25	7.12	224
F21050AP	6.0	5.0	25.94	6.31	8.75	14.50	6.25	1.250	9.00	3.25	7.12	235
F11125M	3.0	2.5*	19.62	5.31	7.12	8.18	4.44	1.125	8.06	2.32	6.12	153
F21125M	3.0	2.5*	20.94	6.31	7.12	9.50	4.44	1.250	8.06	2.32	6.12	178
F11125P	3.0	2.5*	22.34	5.31	7.12	10.90	4.44	1.125	8.06	2.32	6.12	160
F21125P	3.0	2.5*	23.75	6.31	7.12	12.31	4.44	1.250	8.06	2.32	6.12	180
F21140M	5.0	4.0*	21.24	6.31	7.75	9.80	4.75	1.250	9.00	2.62	6.50	225
F21140P	5.0	4.0*	24.06	6.31	7.75	12.62	4.75	1.250	9.00	2.62	6.50	227
F21220AM	2.5	2.0	20.32	6.31	7.88	8.88	4.06	1.250	7.75	2.12	6.81	179
F21220AP	2.5	2.0	23.13	6.31	7.88	11.69	4.06	1.250	7.75	2.12	6.81	185
F21230AM	4.0	3.0	20.63	6.31	8.38	9.19	4.31	1.250	9.00	2.25	7.12	187
F21230AP	4.0	3.0	23.38	6.31	8.38	11.94	4.31	1.250	9.00	2.25	7.12	194
F21240AM	5.0	4.0	20.88	6.31	9.00	9.44	4.56	1.250	9.00	2.44	7.50	207
F21240AP	5.0	4.0	23.63	6.31	9.00	12.19	4.56	1.250	9.00	2.44	7.50	214
F21250AM	6.0	5.0	22.13	6.31	9.50	10.69	5.81	1.250	9.38	3.50	8.00	232
F21250AP	6.0	5.0	24.88	6.31	9.50	13.44	5.81	1.250	9.38	3.50	8.00	238

*Optional 250 Lb. ANSI Discharge Flange is available on 1125 & 1140 Pumps Only.

CUSTOMER _____ JOB NAME _____
P.O. NO. _____ ITEM NO. _____
S.O. NO. _____ SERIAL NO. _____
PUMP SERIES, TYPE, STYLE _____ RPM _____ G.P.M. _____ TOTAL HD. FT. _____
CERTIFIED FOR ☐ APPROVAL ☐ CONSTRUCTION BY _____ DATE _____

Subject to change unless certified for construction.

DT4851776
Rev. 7-91